

Ref.No: 37/RFO/Ballari/2022.

ಶ್ರೀದೇಶಿಕ ಅಗ್ನಿಶಾಮಕ ಅಧಿಕಾರಿಯವರ ಕಛೇರಿ
ಕರ್ನಾಟಕ ರಾಜ್ಯ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು
ಪುನರುಜ್ಜೀವನ ಸೇವೆಗಲು.
ಬಳ್ಳಾರಿ ವಲಯ, ಇನ್‌ಫಂಟ್ರಿ ರಸ್ತೆ, ಬಳ್ಳಾರಿ-04
Dated: 11/03/2022.

ANNEXURE-1
(Up to 14.99 mtrs in height)
Group B, Educational Buildings

(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory.)

To,
The Head Master
Haripriya English Medium
School- Kushtagi,
Kushtagi Tq, Koppala Dist.

Sir,

Sub: Issue of "Fire Safety recommendation" to "Haripriya English Medium School" Located at Koppala Main Road, Kushtagi, Kushtagi Taluk, Koppala Dist.

Ref : Applicant Request Letter Dated: 08/03/2022

With reference to the subject above cited, the premises of "Haripriya English Medium School" Located at Koppala Main Road, Kushtagi, Kushtagi Taluk, Koppala Dist. was inspected by me on Dated 09/03/2022 with respect to fire prevention, fire fighting and evacuation measures to be complied premises and Submitted building details as under.

A. Details of the Building/Premises:-

01.	Name and Address of the applicant.	:	The Head Master Haripriya English Medium School- Kushtagi, Kushtagi Tq, Koppala Dist.	
02.	Name and Address of the premises.	:	Haripriya English Medium School" Koppala Main Road, Kushtagi, Kushtagi Taluk, Koppala Dist.	
03.	Name and Address of the Building owner.	:	The Secretary Haripriya Education Foundation Kushtagi, Kushtagi Taluk, Koppala Dist.	
04.	Number of Buildings	:	02 No Building.	
05.	Number of floors	:	Block-01 Ground + 01 Upper Floor Block-02 Ground Floor.	
06.	Floor-wise details of occupancy :-			
	Ground Floor:	:	Block-01 Class Room- 06 No's Toilets- 02 No's	Block-02 Staff Room- 01 No Office Room- 01 No.
	First Floor	:	Block-01 Class Room- 06 No's	--
07.	Height of the building	:	07.00 Mtrs.	
08.	Site area	:	4047.00 Sq.Mtr	

09	Built-up area of each floor :-		
	Ground Floor :	:	1965.032 Sq.Mtr
	First Floor :	:	1965.032 Sq.Mtr
10	Total built-up area :	:	3930.064 Sq.Mtr
11	Surrounding properties:-		
	East :	:	09 Mtr wide Kushtagi to Koppala Main Road
	West :	:	Open Space
	North :	:	Functional Hall
	South :	:	Open Space
12.	Set back area available around the Building:-		
	East :	:	20.00 Mtr
	West :	:	06.00 Mtr
	North :	:	10.00 Mtr
	South :	:	04.00 Mtr
			Recommended: To provide as per Local Zonal Regulations.

B. On inspection of this Educational premises, the following fire prevention, fire fighting and evacuation measures are recommended & are considered absolutely essential from fire safety point of view:-

Sl. No. [01]	Details [02]	Existing [03]	Recommendations [04]																		
01	Accessibility to Premises.	The premises is accessible from 09 Mtr Wide Kushtagi to Koppala Main Road at East side.	Adequate.																		
02	No of entrances.	01 No	Complied With.																		
03	No. of staircases available	<table border="1"> <tr> <td>No of staircase</td> <td>:</td> <td>01 No</td> </tr> <tr> <td>Width of staircase</td> <td>:</td> <td>01.50 Mtrs</td> </tr> <tr> <td>Width of treads</td> <td>:</td> <td>30 cms</td> </tr> <tr> <td>Height of risers</td> <td>:</td> <td>15 cms</td> </tr> <tr> <td>No of riser per flight</td> <td>:</td> <td>13 riser per flight</td> </tr> <tr> <td>Height of handrails</td> <td>:</td> <td>01.00 Mtrs</td> </tr> </table>	No of staircase	:	01 No	Width of staircase	:	01.50 Mtrs	Width of treads	:	30 cms	Height of risers	:	15 cms	No of riser per flight	:	13 riser per flight	Height of handrails	:	01.00 Mtrs	Recommended to Provide One More Stair case of width 01.50
No of staircase	:	01 No																			
Width of staircase	:	01.50 Mtrs																			
Width of treads	:	30 cms																			
Height of risers	:	15 cms																			
No of riser per flight	:	13 riser per flight																			
Height of handrails	:	01.00 Mtrs																			
04	Fire extinguisher	<p>Provided.</p> <p>01 No of 11.50 Kg capacity ABC FE & 02 No of 06 Kg capacity ABC FE & 01 No of 04 Kg capacity ABC FE</p>	<p>01) 05 no's ABC FE each of 5 kg capacity in each floor for Block-01 & 01 no ABC FE each of 5 kg capacity for Block-02</p> <p>02) 01 No of CO2 extinguisher of 4.5 kg capacity near the Electrical Switch</p>																		

- board.
- 03) 08 No's of sand Bucket for Electrical Switch board.
 - 04) Two number of Hand gloves near the Electrical Switch board.
 - 05) 01 No's Water Mist type extinguishers of 09 liters capacity should be kept near each staircase landing at each floor.
 - 06) 01 No Mechanical Foam FE of 9 Ltrs capacity and 01 No ABC FE of 6 kg capacity should provide near Diesel Generator.

[All the extinguishers suggested above should be with B.I.S. markings and should be located at an easily accessible position without obstructing the normal passage and maintained periodically]

05	Hose reel hose system.	Not Provided.	01 No of Hose reel hose of 30 mtr length with drum and 01 no's delivery hose pipes minimum 2 ½ inch size of adequate length to reach the farthest point of each floor has to be provide with a shut off branch having a nozzle of 2 mm size. The hose reel hose has been connected at each landing by means of an adaptor.
06	At the terrace tank level with minimum pressure of 3.5 kg/cm ²	Not Provided.	To Provide 01 No pump with minimum pressure of 450 LPM.

07	Diesel generators.	Not Provided.	One Adequate Capacity Generator Should Provide and it should be connected to alternate power supply.
08	Terrace tank.	Provided 01 No. Of 1000 Ltr Capacity 01 Syntax Tank & 01 No. Of 10,000 Capacity UG Tank Provided	To Provide Over Head Tank of 10,000 Ltrs for Fire Fighting purpose to be connected to Hose reel hose system.
09	Escape routes	Not Marked	Signage board is required with illuminated points for in which direction to go outside from the building for staff & students and also separate light arrangement to the illumination board by doing from battery operated
10	Fire order (Fire Safety Plans)	Not Displayed	The Notice board have been indicted the action should be taken by the employees in case of any emergency should be displayed with the telephone number of Kushtagi Fire Station i.e- 08356-268101 & 101, and the telephone number of nearest Ambulance services and Police Station.
11	No Smoking Board	Not Displayed	COTPA Sec-4 Direction No Smoking area Smoking hear is an offence Board Should be written in English & Kannada both language Shall be Prominently displayed at inside the Entry/Exist of Each Floor.
12	Fire Siren	Not Installed	A fire Siren shall be installed in the premises to inform the inmates in case of a fire emergency/evacuate the area
13	Nominate one fire Nodal officer	--	A fire nodal officer shall be nominated either from teaching or no teaching staff.

14	Fire fighting training.	Not Imparted	At-least 40% of School Staff should be got trained in basic fire fighting at R.A.Mundkur fire & Emergency Services Academy, Bannerughatta road, Bangalore within 3 months or at an early date.
----	-------------------------	--------------	--

15) Fire Precautionary Measures:

- 1) Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory and electrical cum panel premises.
- 2) Accumulation of combustible waste in and around the premises should be avoided.
- 3) The exit ways shall be always kept clear without any Obstruction.
- 4) Liquefied petroleum gas should not be stored in the building.
- 5) The doors shall not be kept locked / latched during working hours and shall be free from obstruction.
- 6) During the class hours the class room doors shall not be locked from inside to outside.
- 7) As per Honorable supreme court order all teachers and staffs shall be trained to handle safety equipment, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the fire safety day on 14th of every year by conducting fire safety drills with co-ordinate with fire service department.


Hence this "Fire Safety recommendation" is issued to of "Haripriya English Medium School" Located at Koppala Main Road, Kushtagi, Kushtagi Taluk, Koppala Dist. subject to strict adherence of the conditions as laid down in this Recommendations and to check the portable fire extinguisher & Hose reel hose, and to conduct drills periodically and the Management must not extend the height of the building beyond 15.0 meters. Subject to condition and compliance of the above recommendations in column-4 of serial-B within 3 months and compliance to undersigned.

The "Fire Safety recommendation" is valid for only one year from the date of issue and it is renewable.

Date- 11-03-2022.

Place- Ballar

Yours faithfully,


 ಸಿ.ಎಚ್.ಎಚ್. ಅಧಿಕಾರಿ
 ಕರ್ನಾಟಕ ರಾಜ್ಯ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು
 ತುರ್ತು ಸೇವೆಗಳು
 ಬಳ್ಳಾರಿ ವಲಯ, ಬಳ್ಳಾರಿ-04

HARIPRIYA EDUCATION FOUNDATION (TRUST) (R)
HARIPRIYA ENGLISH MEDIUM HPS KUSTAGI
Koppal Main Road, Kushtagi – 583277

Tq: Kushtagi

Mob.No : 7892849086, 9902474548

Dist: Koppal

Gmail Id : rishivanna2022@gmail.com




Translation of rubber stamp matter from kannada to English

Translation of rubber stamp matter from kannada to English
Sri.Venkappacharya Prahaladacharya a panel translator of govt of
Karnataka and notary public here by notaries the below mentioned
Round rubber stamp translation from kannada to English

ಪ್ರಾದೇಶಿಕ ಅಗ್ನಿಶಾಮಕ ಅಧಿಕಾರಿಯವರ ಕಛೇರಿ
ಕರ್ನಾಟಕ ರಾಜ್ಯ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು
ತುರ್ತು ಸೇವೆಗಳು
ಬೆಳ್ಳಾರಿ ವಲಯ, ಇನ್ ಪೆಂಟ್ರಿ ರಸ್ತೆ ಬೆಳ್ಳಾರಿ-04

Regional Fire Officer Office
Karnataka State Fire and Emergency services
Bellary sector Infantry Road Bellary-04

Attested


Venkappacharya
Prahaladacharya
BA.LL.B(Spl)
Advocate & Notary Public
Kushtagi-583277.Dt:Koppal

12/04/2024

ಹರಿಪ್ರಿಯ ಶಿಕ್ಷಣ ಪ್ರತಿಷ್ಠಾನ (ಟ್ರಸ್ಟ್) ರಿ

ಕೊಪ್ಪಳ ಮುಖ್ಯ ರಸ್ತೆ, ಕುಷ್ಟಗಿ - 583277

ಹರಿಪ್ರಿಯ ಆಂಗ್ಲ ಮಾಧ್ಯಮ ಹಿರಿಯ ಪ್ರಾಥಮಿಕ ಶಾಲೆ, ಕುಷ್ಟಗಿ

ಕ್ರ.ಸಂ: 13

ದಿನಾಂಕ: 19-02-2024

ಗೆ,

ಮಾನ್ಯ ಜಿಲ್ಲಾ ಅಗ್ನಿಶಾಮಕ ಅಧಿಕಾರಿಗಳು

ಕರ್ನಾಟಕ ರಾಜ್ಯ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವೆಗಳು

ಅಗ್ನಿಶಾಮಕ ರಾಣಿ, ಕೊಪ್ಪಳ

ಕೊಪ್ಪಳ-583231

ಮಾನ್ಯರೇ,

ವಿಷಯ: " To issue the Certificate of Fire Safety "

ಮೇಲ್ಕಾಣಿಸಿದ ವಿಷಯಕ್ಕೆ ಸಂಬಂಧಿಸಿದಂತೆ ತಮ್ಮಲ್ಲಿ

ವಿನಂತಿಸಿಕೊಳ್ಳುವುದೇನೆಂದರೆ ಹರಿಪ್ರಿಯ ಆಂಗ್ಲ ಮಾಧ್ಯಮ ಶಾಲೆ ಕುಷ್ಟಗಿ ಈ

ನಮ್ಮ ಶಾಲೆಯು ರಾಜ್ಯ ಪಠ್ಯಕ್ರಮದ ಅನುಮತಿಯೊಂದಿಗೆ ನಡೆಯುತ್ತಿದ್ದು

ಮುಂದಿನ ಶೈಕ್ಷಣಿಕ ವರ್ಷದಿಂದ ಕೇಂದ್ರ ಪಠ್ಯಕ್ರಮಕ್ಕೆ ಸಂಯೋಜನೆಗೊಳಿಸಲು

ಈ ಮೇಲ್ಕಾಣಿಸಿದ ಪ್ರಮಾಣ ಪತ್ರ ಅಗತ್ಯವಾಗಿ ಬೇಕಾಗಿರುವುದರಿಂದ ದಯವಿಟ್ಟು

ತಾವುಗಳು ನಮ್ಮ ಮನವಿಯನ್ನು ಸ್ವೀಕರಿಸಿ ಈ ಅಗ್ನಿಸುರಕ್ಷತಾ ಪ್ರಮಾಣ

ಪತ್ರವನ್ನು ನೀಡಬೇಕಾಗಿ ವಿನಂತಿ.

ಧನ್ಯವಾದಗಳೊಂದಿಗೆ

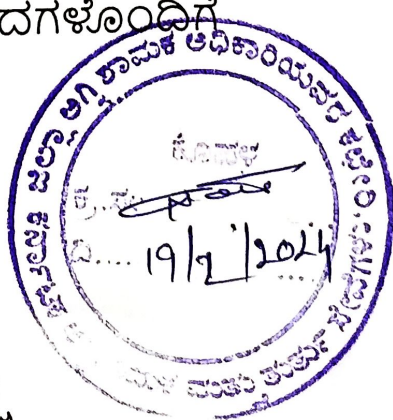
ಸ್ಥಳ: ಕುಷ್ಟಗಿ

ದಿನಾಂಕ: 19/02/2024

ಲಗತ್ತುಗಳು:

- ಕಟ್ಟಡದ ನೀಲನಕ್ಷೆ
- ಶಾಲಾ ನೋಂದಣಿ ಪತ್ರ
- Leas Deed
- Land NA Copy
- Fire safety Certificate

* ಶಾಲಾ ಸಂರಕ್ಷಣೆ ಮತ್ತು ಸುರಕ್ಷತೆ ಕ್ರಮಗಳು
* ಅಗ್ನಿ ಸುರಕ್ಷತಾ ಕ್ರಮಗಳನ್ನು ಕೈಗೊಳ್ಳುವ ಕ್ರಮಗಳು



ಇಂತಿ ನಿಮ್ಮ ವಿಶ್ವಾಸಿ

For Hanpriya Education Foundation Trust Kushta

Secretary

HARIPRIYA EDUCATION FOUNDATION (TRUST) (R)
HARIPRIYA ENGLISH MEDIUM HIGHER PRIMARY SCHOOL KUSTAGI
Koppal Main Road, Kushtagi – 583277

Tq: Kushtagi

Mob.No : 7892849086, 9902474548

Dist: Koppal

Gmail Id : rishivanna2022@gmail.com

To,
District Fire Officer
Karnataka State Fire and Emergency services
Fire Station, Koppal

Respected sir,

Sub : " To issue the Certificate of Fire Safety "

As above subject I am the Headmaster of Haripriya English Medium School Kushtagi. We are running our school with the affiliation of Karnataka state government but in the next academic year we would like to affiliate with the CBSE, So we required fire safety compliance certificate kindly we request you to issue the same.

Thanking you.

Place : Kushtagi

Date : 19/02/2024

Head master

Documents

- Building blue print
- School Registration letter
- Leas deed
- Land NA copy
- Fire safety certificate
- Training letter
- Instalments of Fire equipments letters

Translation of rubber stamp matter from Kannada to English

(Name of the Translator) a Panel Translator of Govt. of Karnataka and Notary Public here by notaries the below mentioned Round rubber stamp translation from Kannada to English.

Stamp in Vernacular language


English Translation

ಜಿಲ್ಲಾ ಅಗ್ನಿಶಾಮಕ ಅಧಿಕಾರಿಗಳ
ಕಛೇರಿ, ಕರ್ನಾಟಕ ಅಗ್ನಿಶಾಮಕ
ತುರ್ತು ಸೇವೆಗಳು ಕೊಪ್ಪಳ

Office of the District Fire Officers, Karnataka
Fire Emergency Services Koppal



Attested


**Venkappacharya
Pahaladacharya
B.A.LL.B.(Spl)**

**Advocate & Notary Public
Kushtagi-583277.Dt:Koppal**

12/04/2024